


- NOTES:
1. ALL CONCRETE WALLS AND FLOOR IS 6" THICK.
  2. #4 REBAR 12" O.C. 2.5" COVER ON ALL SIDES.
  3. ALL CONCRETE 3000 PSI AT 28 DAYS W/4% TO 7% AIR ENTRAINMENT, MAX. 4" SLUMP
  4. EA 1/4" DIA X 3" BOLTS AT TOP AND BOT. EVENLY SPACED BEDDED IN CONCRETE TO HOLD RACK IN PLACE

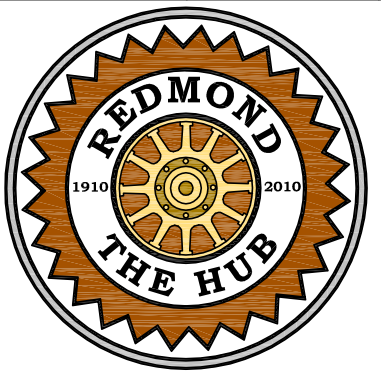



# RESERVOIR DRIVE IMPROVEMENTS ~ DETENTION POND

## CITY OF REDMOND ENGINEERING DEPARTMENT

716 SW EVERGREEN AVENUE REDMOND, OREGON 97756

PH 541.504.2002 FAX 541.923.4035

SCALE: 1"=30'

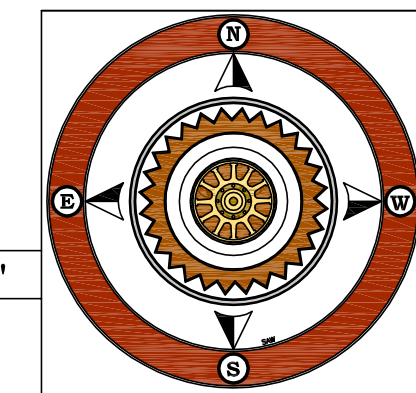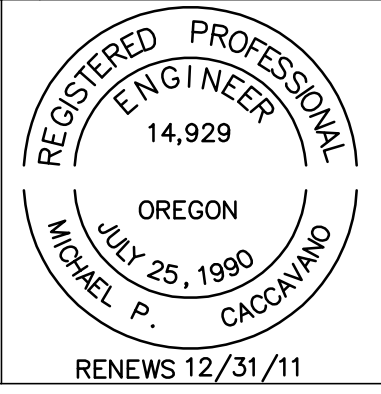

<b>COR PROJECT NUMBER</b> TR 08-03	
<b>REVIEWED BY</b> MPC	<b>FIRST DRAFT DATE</b> 11-18-07
<b>DESIGNED BY</b> SAW	<b>REVISION DATE</b> 04-01-10
<b>DRAFTED BY</b> saw	

<b>REMARKS:</b>	<b>SHEET</b> <b>7</b> <b>OF 10 SHEETS</b>
-----------------	---